




AECOM

Drawn: AA	Date: 11/21/2024
Approved: DB	Date: 11/21/2024
Project #: 60560354	

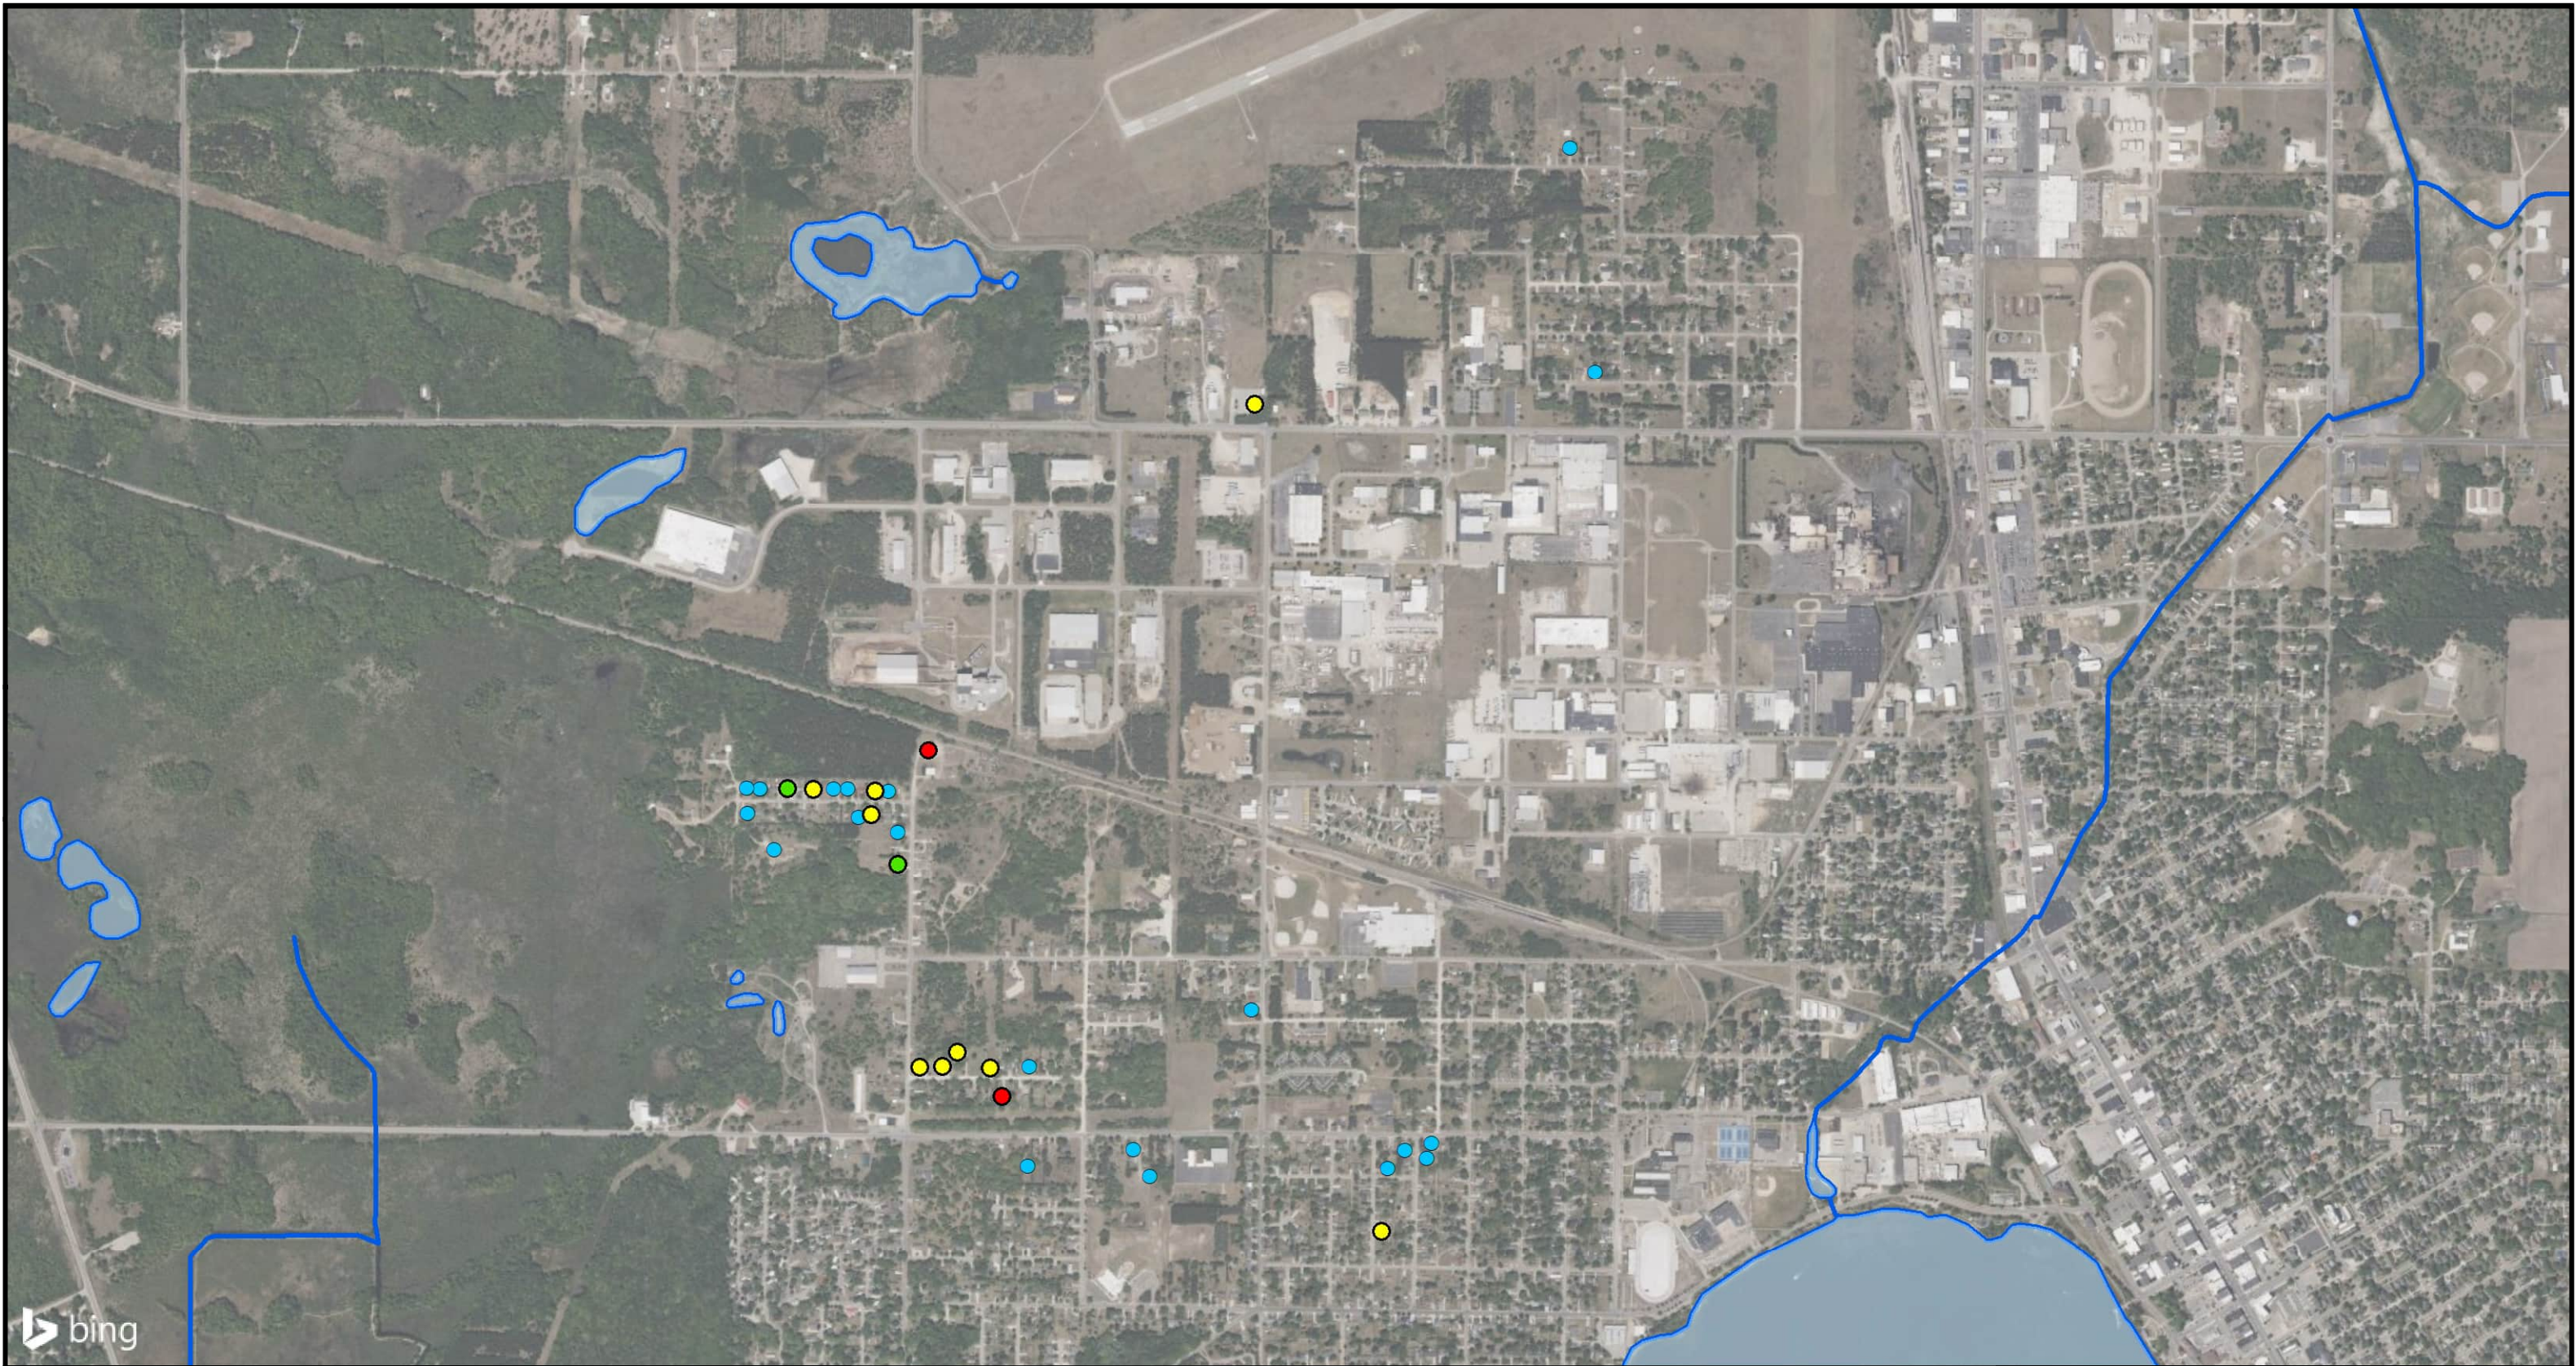

Sample Status

- Sampled – Results Pending

Residential Well Sample

- No Detections of the Analyzed PFAS Substances
- One of more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Detections at or Above Michigan Drinking Water Criteria

— Surface Water Body

Michigan Residential & Nonresidential Drinking Water Criteria (DWC), ppt:

PFHxA = 400,000	PFBS = 420
PFOA = 8	PFHxS = 51
PFNA = 6	PFOS = 16

0 1,800 3,600 Feet

N

FIGURE 2

PFAS HEAT MAP
CADILLAC INDUSTRIAL PARK SITE
WEXFORD COUNTY, MI